

Minimum flows in community water supply and water race rivers

RWC Workshop 4 September 2017



Minimum flows in community water supply and water race rivers


- **Waingawa, Waiohine, Tauherenikau [Mangatarere]**
- **Suggested minimum is at current minimum (consented and pNRP) at which water takes must cease (other than community water supply and water races)**
- **But in reality takes are restricted according to several flow thresholds**

Waingawa River

- **Flow that represents committee habitat objective is 1,300 L/s**
- **In the pNRP there are three flow thresholds:**
 - **1,900 L/s**
 - **1,700 L/s**
 - **1,100 L/s**


Waingawa River

- At flows above 1,900 L/s
- Available allocation is 1,200 L/s

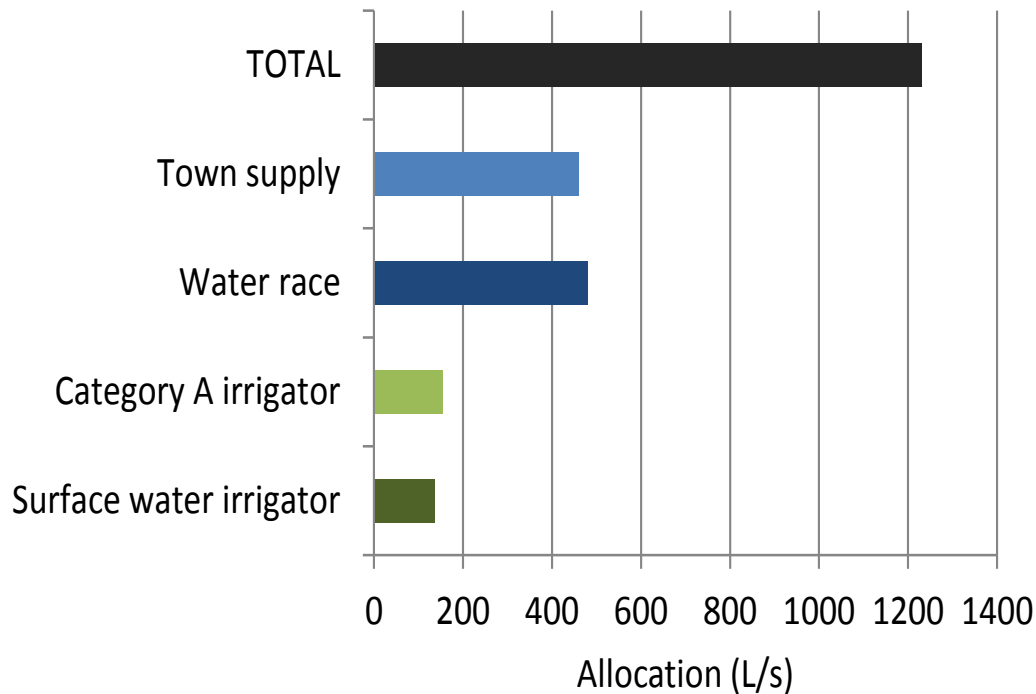


Waingawa River

- At flows between 1,900 and 1,700 L/s
- Available allocation is 880 L/s

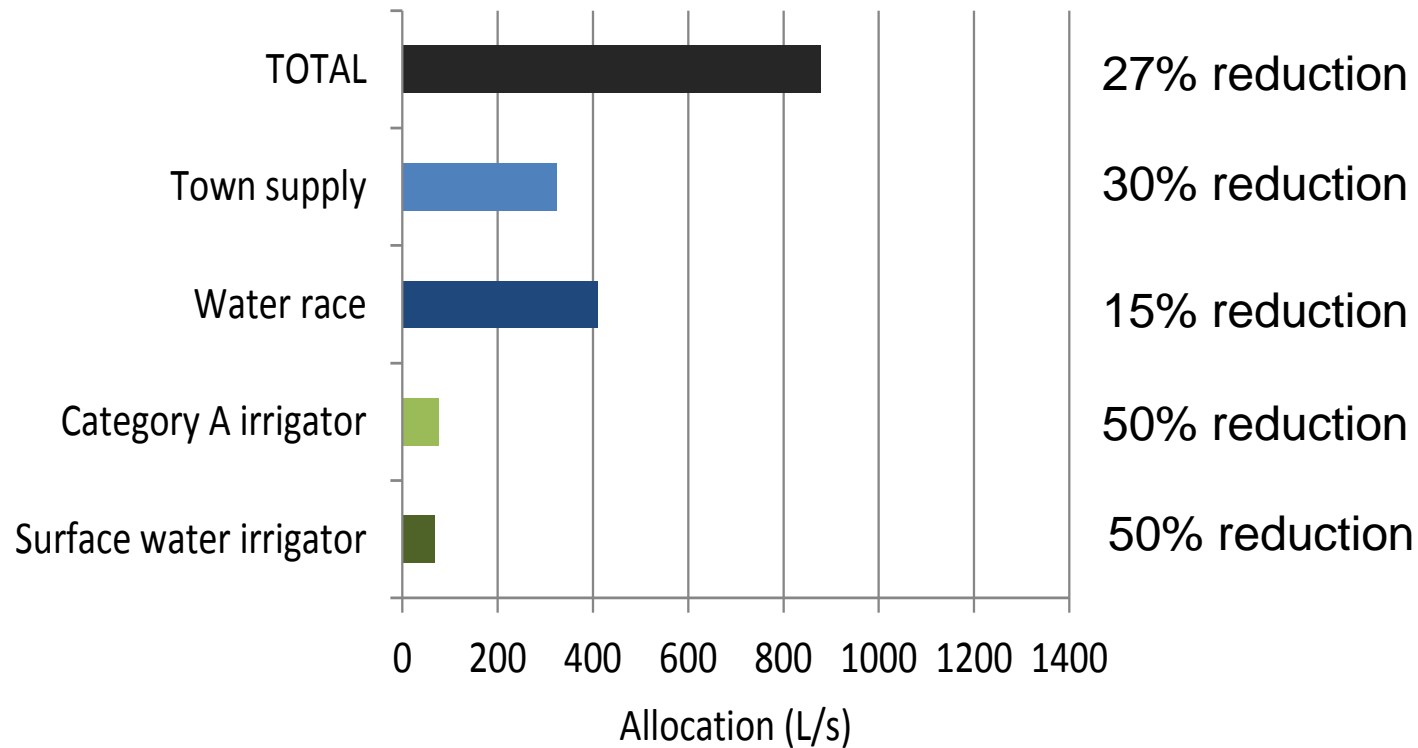

Waingawa River

- At flows below 1,700 but above 1,100 L/s
- Available allocation is 770 L/s

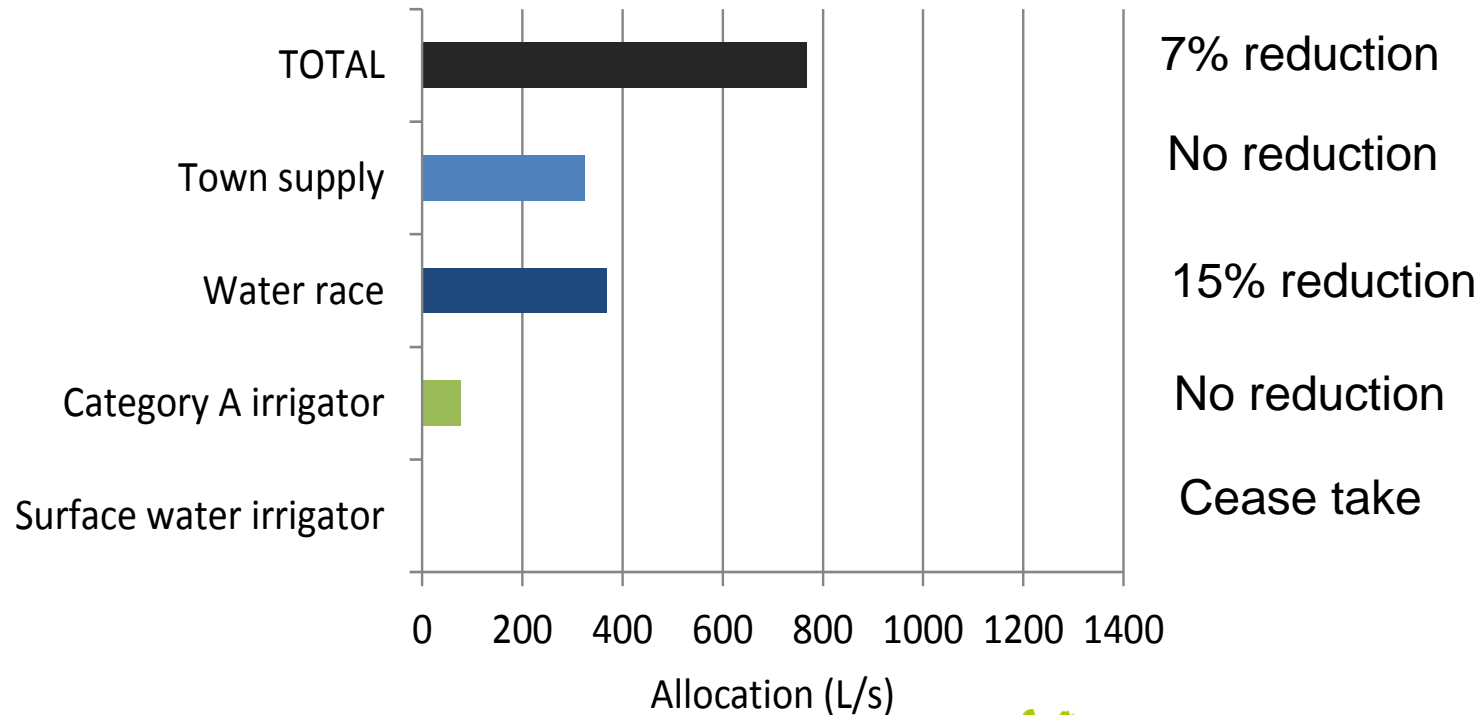

Waingawa River

- At flows below 1,100
- Available allocation is 770 L/s – no reductions

